


MAX PANEL SUPPLY PROTECTIVE DEVICE RATING:

1000 AMPS

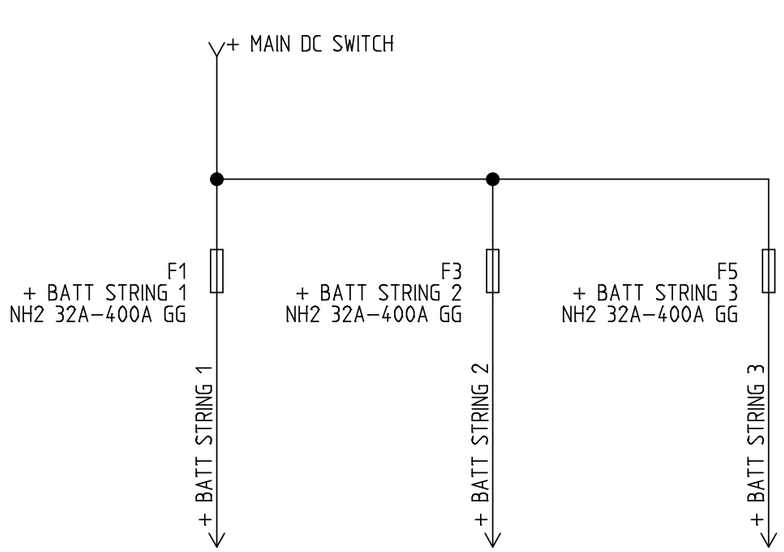

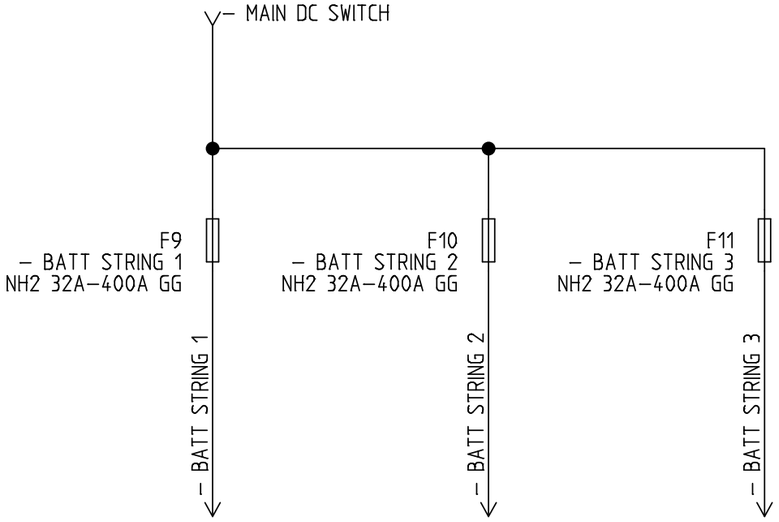

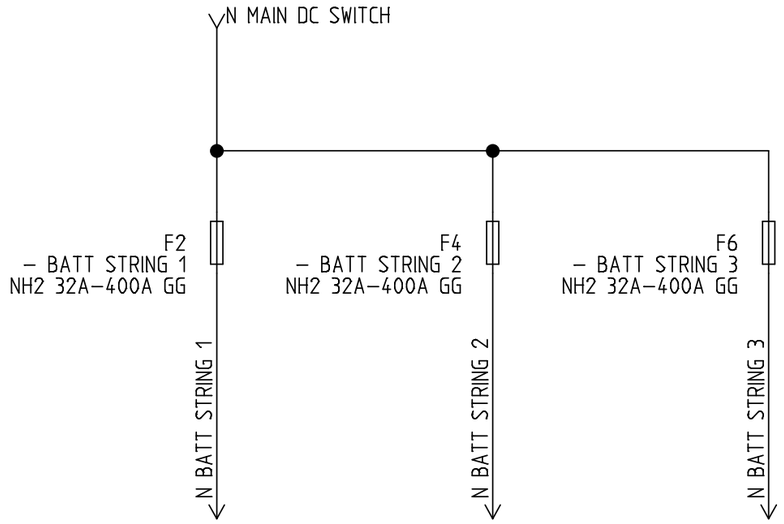

FUSE RATING OPTIONS:

32A
63A
100A
125A
160A
200A
250A
315A
400A

PLEASE SPECIFY ON ORDER

EARTH

EARTH


NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 – CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL


PRODUCT REF:	RB1–DC–F10–400–3P–3S	REV NO:	1
DOCUMENT NUMBER:	RBECAD01359	CREATION DATE:	29/04/2016
PAGE DESCRIPTION:	MAIN SWITCH'S	REV DATE:	28/08/2025
PROJECT NO:	SUBMITTAL DRAWING	DRAWN BY:	L RICHARDSON
PAGE TEMPLATE REF:	RBQS00075REV2	CHECKED BY:	D WARD
PRODUCT WEIGHT:	50KG	SHEET NUMBER:	1 OF 2

MECHANICAL LAYOUT


TOP VIEW:

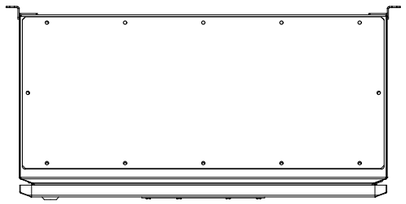


LEFT VIEW:

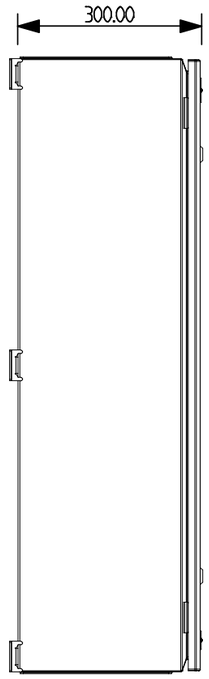


FRONT VIEW:

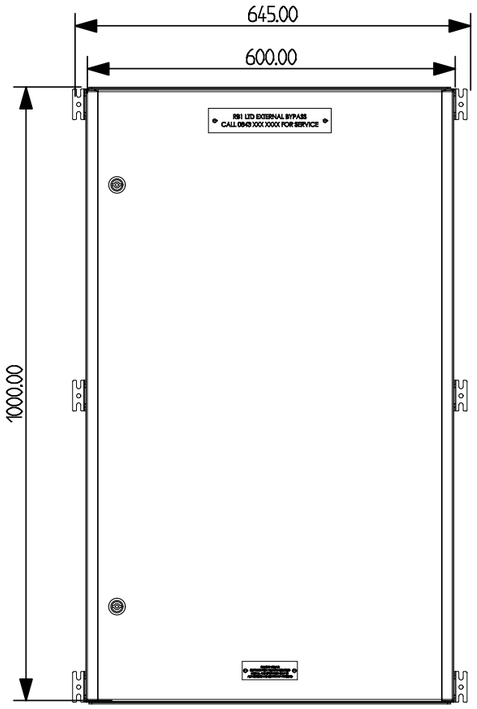

ISO VIEW:

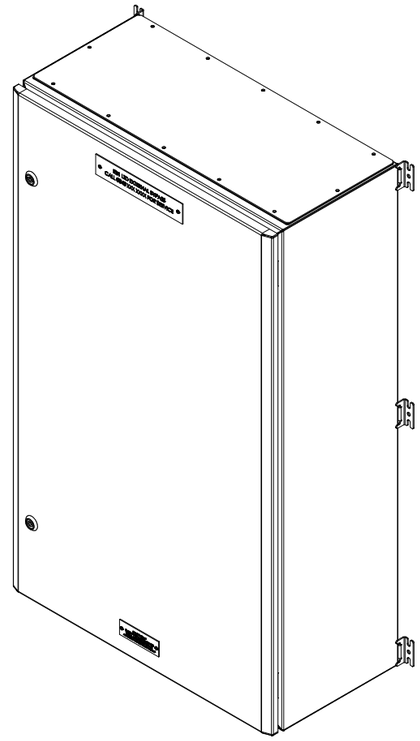

BOTTOM VIEW:

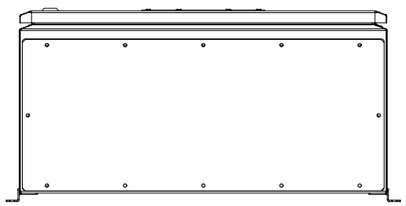

CABLE GLANDING:

MAIN DC FEED: TOP/BOTTOM
BATTERY FEEDS: TOP/BOTTOM

CABLE TERMINATIONS:

MAIN DC FEED: 1 x M10 BOLT
BATTERY CONNECTIONS: M10 BOLT
EARTH: M6/M8 BOLT

NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 – CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL

PRODUCT REF:	RB1–DC–F10–400–3P–3S	REV NO:	1
DOCUMENT NUMBER:	RBECAD01359	CREATION DATE:	29/04/2016
PAGE DESCRIPTION:	MECHANICAL LAYOUT	REV DATE:	28/08/2025
PROJECT NO:	SUBMITTAL DRAWING	DRAWN BY:	L RICHARDSON
PAGE TEMPLATE REF:	RBQS00078REV2	CHECKED BY:	D WARD
PRODUCT WEIGHT:	50KG	SHEET NUMBER:	2 OF 2