

MAX PANEL SUPPLY PROTECTIVE DEVICE RATING:

200 AMPS

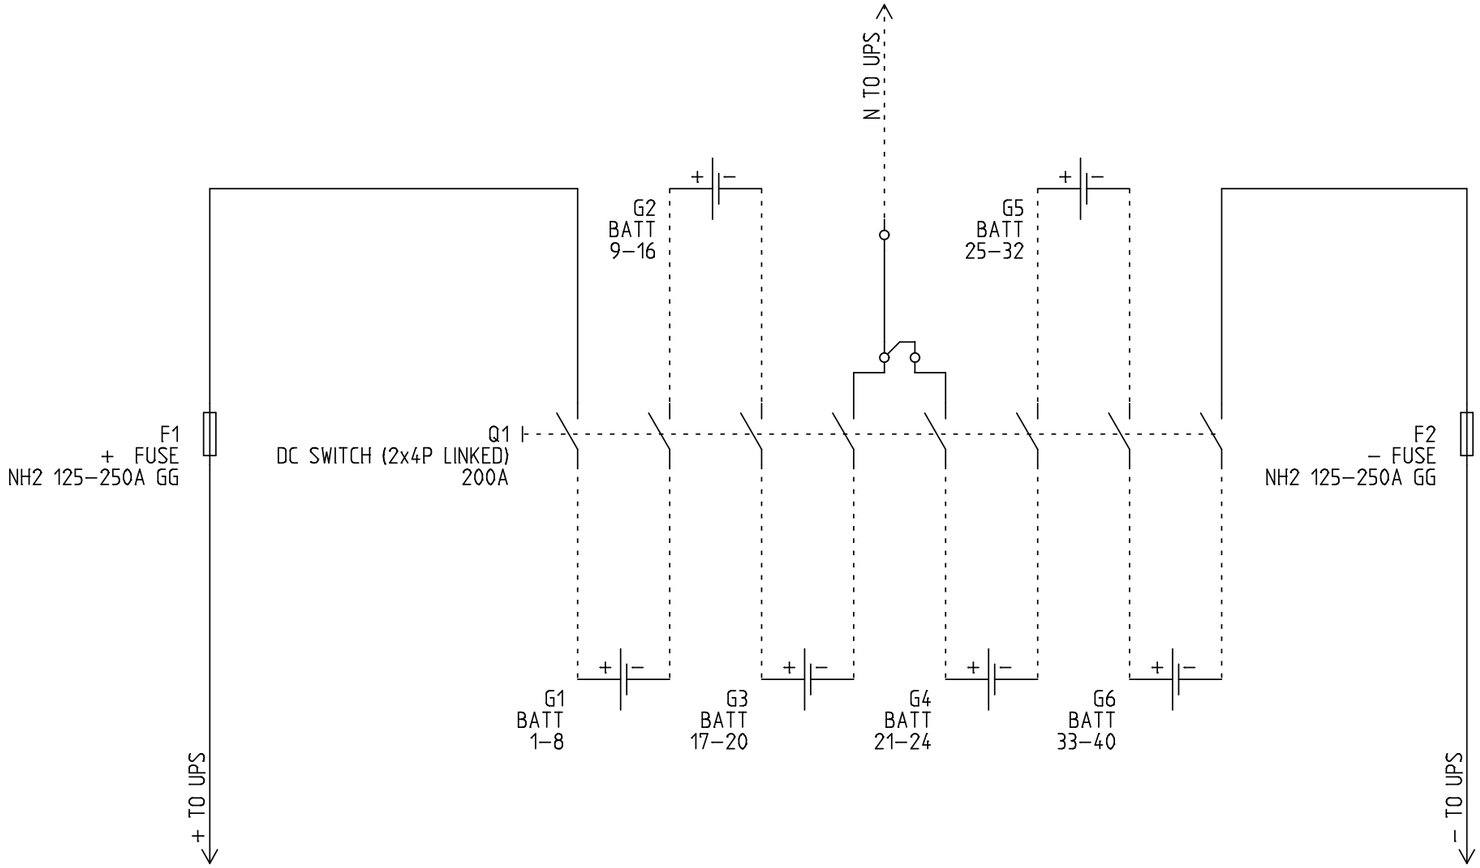


INTERLOCK AUXILLARIES
MUST BE CONNECTED TO UPS
MANUAL BYPASS SIGNAL INPUT
UPS ENGINEER WILL TERMINATE
UPS END OF CABLE

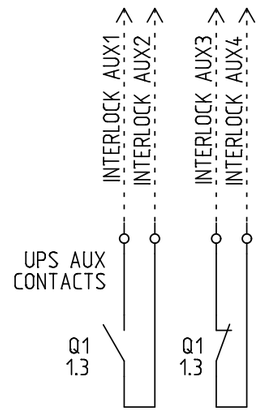


EARTH

EARTH

| NO | NC |
|---|---|
| 1.8 | 1.9 |


NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 – CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL


| | | | |
|---|---|---|---|
| PRODUCT REF: | RB1–DC–ISO–200A–3P–1S–5B–120V | REV NO: | 1 |
| DOCUMENT NUMBER: | RBECAD00934 | CREATION DATE: | 29/04/2016 |
| PAGE DESCRIPTION: | MAIN SWITCH | REV DATE: | 13/03/2023 |
| PROJECT NO: | SUBMITTAL DRAWING | DRAWN BY: | L RICHARDSON |
| PAGE TEMPLATE REF: | RBQS00075REV2 | CHECKED BY: | D WARD |
| PRODUCT WEIGHT: | 30 KG | SHEET NUMBER: | 1 OF 2 |

# ENCLOSURE LAYOUT


## TOP VIEW

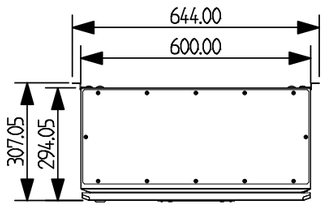



## BOTTOM VIEW

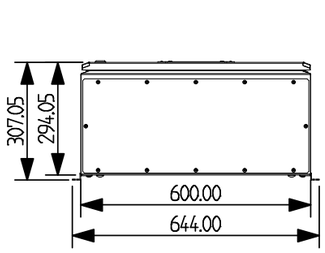



# LEFT VIEW

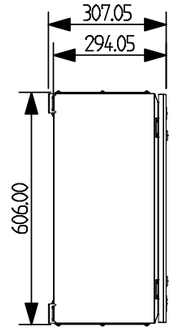



# FRONT/REAR VIEW

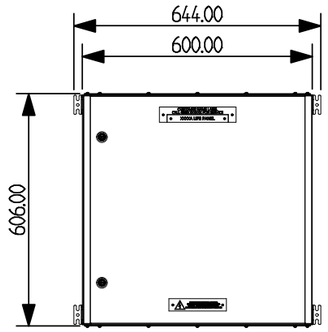


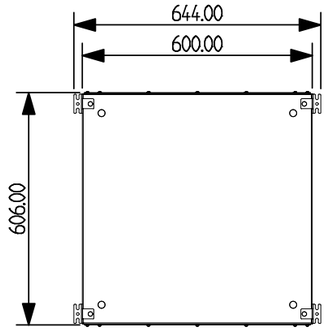
# RIGHT VIEW

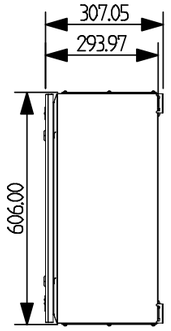


# ISOMETRIC VIEW

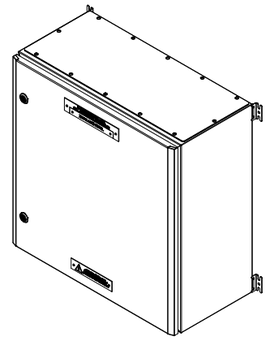

# NOTES ON MECHANICAL LAYOUT:

1. ENCLOSURE CAN BE INSTALLED WITHOUT MOUNTING FEET IF PREFERRED
2. DOOR CAN BE HUNG ON OPPOSITE SIDE ON REQUEST

NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 – CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL

| | | | |
|---|---|---|---|
| PRODUCT REF: | RB1–DC–ISO–200–3P–1S–5B–120V | REV NO: | |
| DOCUMENT NUMBER: | RBECAD00934 | CREATION DATE: | 03/02/2021 |
| PAGE DESCRIPTION: | MECHANICAL LAYOUT | REV DATE: | 03/02/2021 |
| PROJECT NO: | SUBMITTAL DRAWING | DRAWN BY: | L RICHARDSON |
| PAGE TEMPLATE REF: | RBQS00075REV2 | CHECKED BY: | D WARD |
| PRODUCT WEIGHT: | 25 KG | SHEET NUMBER: | 2 OF 2 |