

MAX PANEL SUPPLY PROTECTIVE DEVICE RATING:

250 AMPS

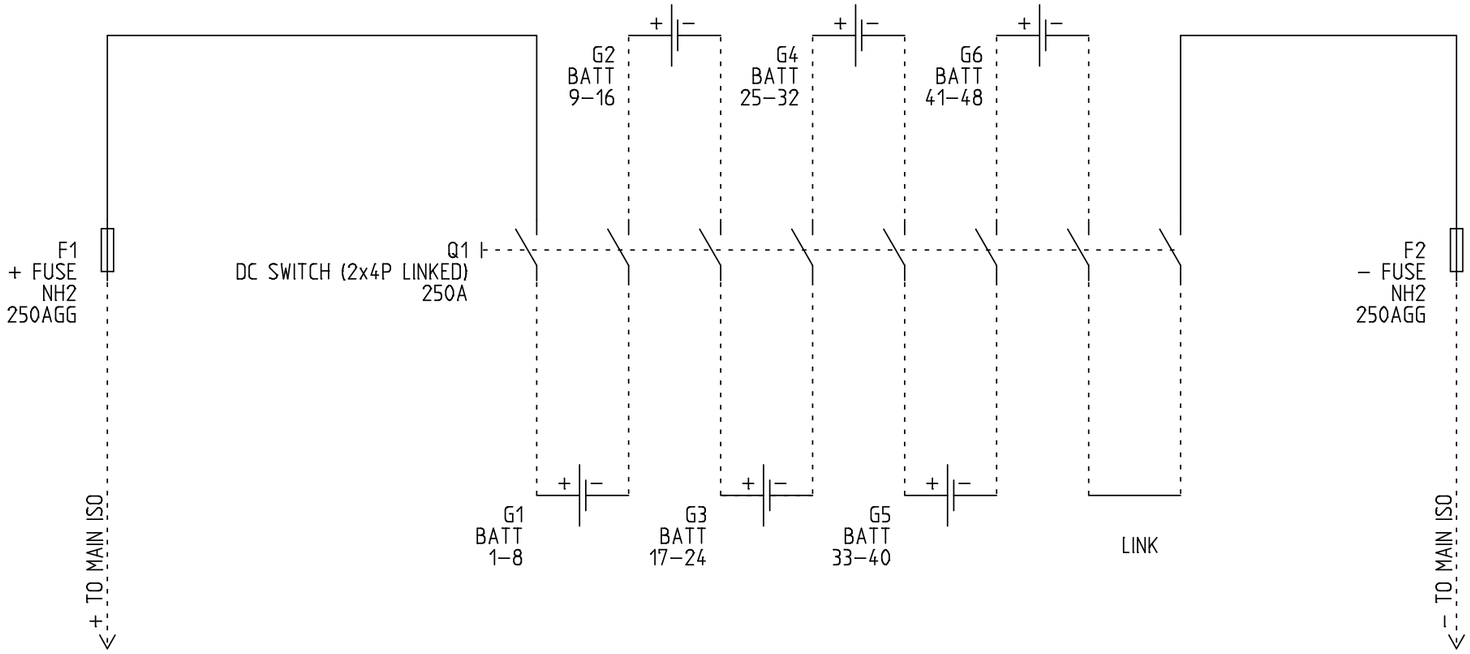

INTERLOCK AUXILLARIES
MUST BE CONNECTED TO UPS
MANUAL BYPASS SIGNAL INPUT
UPS ENGINEER WILL TERMINATE
UPS END OF CABLE

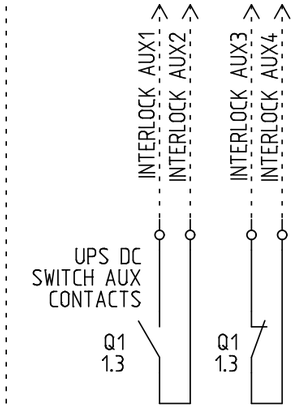

PLEASE NOTE THIS PANEL IS FOR 1 STRING.
1 PANEL WILL BE NEEDED PER ADDITIONAL
STRING, PLEASE CONTACT US TO DISCUSS
FUSING PRIOR TO ORDERING IF THIS HAS
NOT BEEN DISCUSSED BEFORE HAND.

THANKYOU

EARTH — EARTH


NO	NC
1.8	1.9

NOTES:
1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 – CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL


PRODUCT REF:	RB1–DC–ISO–250–2P–1S–6B–120V	REV NO:	1
DOCUMENT NUMBER:	RBECAD01196	CREATION DATE:	29/04/2016
PAGE DESCRIPTION:	MAIN SWITCH	REV DATE:	18/10/2024
PROJECT NO:	SUBMITTAL DRAWING	DRAWN BY:	L RICHARDSON
PAGE TEMPLATE REF:	RBQS00075REV2	CHECKED BY:	D WARD
PRODUCT WEIGHT:	35 KG	SHEET NUMBER:	1 OF 2

ENCLOSURE LAYOUT


TOP VIEW

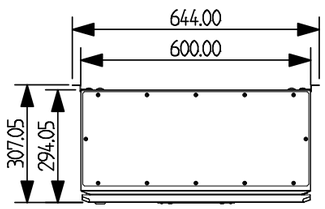


BOTTOM VIEW

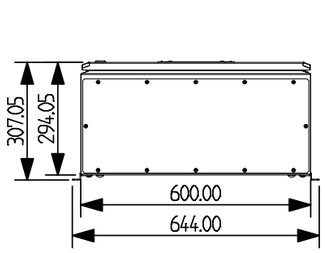


LEFT VIEW

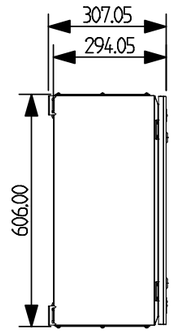


FRONT/REAR VIEW

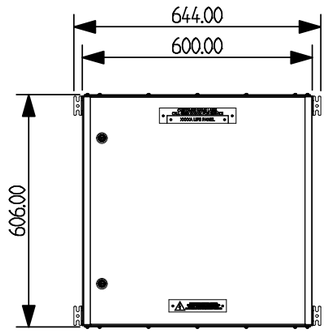


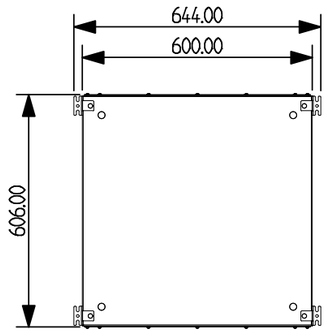

RIGHT VIEW

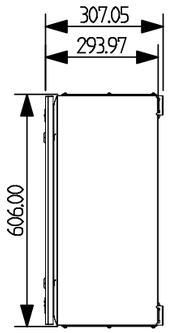

ISOMETRIC VIEW

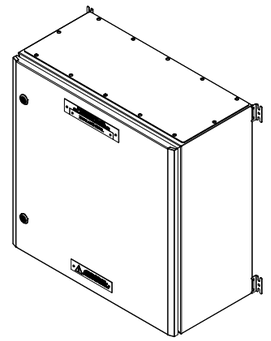

NOTES ON MECHANICAL LAYOUT:

1. ENCLOSURE CAN BE INSTALLED WITHOUT MOUNTING FEET IF PREFERRED
2. DOOR CAN BE HUNG ON OPPOSITE SIDE ON REQUEST

NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 – CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL

PRODUCT REF:	RB1–DC–ISO–250–2P–1S–6B–120V	REV NO:	1
DOCUMENT NUMBER:	RBECAD01196	CREATION DATE:	22/02/2023
PAGE DESCRIPTION:	MECHANICAL LAYOUT	REV DATE:	29/08/2023
PROJECT NO:	SUBMITTAL DRAWING	DRAWN BY:	L RICHARDSON
PAGE TEMPLATE REF:	RBQS00075REV2	CHECKED BY:	D WARD
PRODUCT WEIGHT:	35 KG	SHEET NUMBER:	2 OF 2