
MAX PANEL SUPPLY PROTECTIVE DEVICE RATING:

125A AMPS

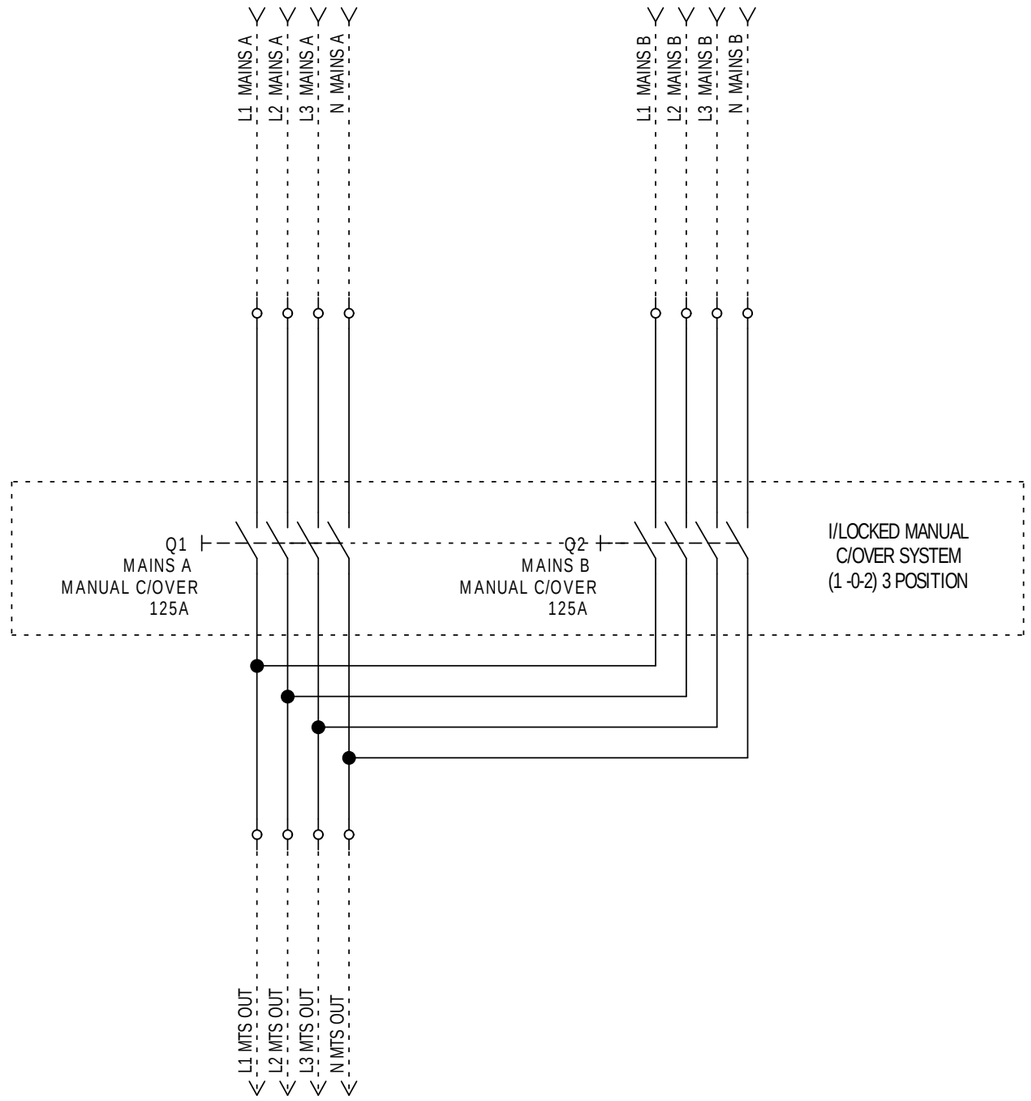



NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 - CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL


| | | | |
|---|---|---|---|
| PRODUCT REF: | RB1-MTS-125-4P-ISO | REV NO: | 1 |
| DOCUMENT NUMBER: | RBECAD00890 | CREATION DATE: | 11/03/2021 |
| PAGE DESCRIPTION: | MTS | REV DATE: | 05/07/2021 |
| PROJECT NO: | SUBMITTAL DRAWING | DRAWN BY: | L RICHARDSON |
| PAGE TEMPLATE REF: | RBQS00075REV2 | CHECKED BY: | D WARD |
| PRODUCT WEIGHT: | 25KG | SHEET NUMBER: | 1 OF 2 |

# MECHANICAL LAYOUT


## TOP VIEW

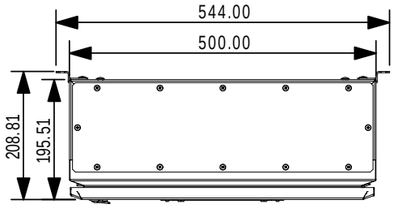



## BOTTOM VIEW

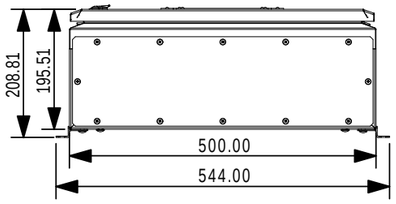



# LEFT VIEW

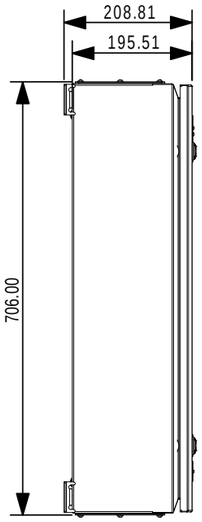



# RIGHT VIEW

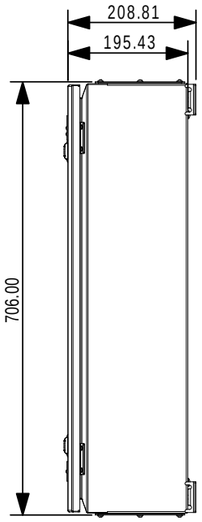



# FRONT/REAR VIEW

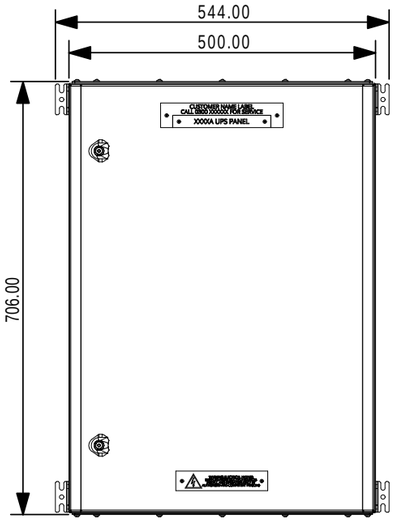
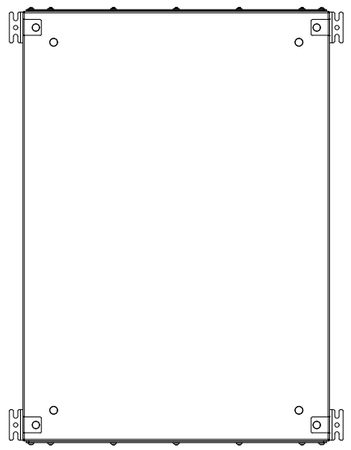
# ISOMETRIC VIEW

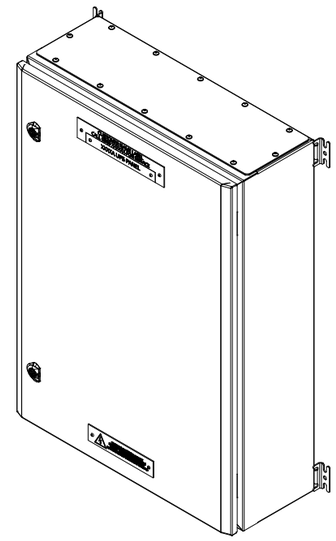

# NOTES ON MECHANICAL LAYOUT:

1. ENCLOSURE CAN BE INSTALLED WITHOUT MOUNTING FEET IF PREFERRED
2. MOUNTING FEET SUPPLIED LOOSE FOR INSTALLER TO FIT
3. DOOR CAN BE HUNG ON OPPOSITE SIDE ON REQUEST

NOTES:

1) PRODUCT MUST BE INSTALLED IN COMPLIANCE WITH ALL NATIONAL AND LOCAL ELECTRICAL REGULATIONS
2) PLEASE REFER TO UPS PRODUCT MANUALS FOR ADDITIONAL INFORMATION
3) ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED
4) 4 - CORE SHIELDED SIGNAL CABLE MUST BE RUN FROM EMBS TO EACH UPS UNIT
5) ALL DASHED LINES EXTERNAL TO BYPASS PANEL

| | | | |
|---|---|---|---|
| PRODUCT REF: | RB1-MTS-125-4P-ISO | REV NO: | 1 |
| DOCUMENT NUMBER: | RBECAD00890 | CREATION DATE: | 29/04/2016 |
| PAGE DESCRIPTION: | MECHANICAL LAYOUT | REV DATE: | 05/07/2021 |
| PROJECT NO: | SUBMITTAL DRAWING | DRAWN BY: | L RICHARDSON |
| PAGE TEMPLATE REF: | RBQS00078REV2 | CHECKED BY: | D WARD |
| PRODUCT WEIGHT: | 25KG | SHEET NUMBER: | 2 OF 2 |